




## Data sheet

### EA15

Measured value display  
with 2.8" Touch LCD



# 1 Product and functional description

## 1.1 Use as intended

The EA15 is a measuring value display unit for measuring transducers with output signals for current and voltage acc. to IEC 60381. Up to four measuring transducers in two or three-conductor versions can be connected.

### Typical applications

- Universal measurement display in an industrial environment.

### Important features

- 2.8" (7.2 cm) TFT Touch LCD colour display
- Configurable colour switching
- 2 or 4 channel mode with ...
  - 2 or 4 configurable analogue inputs  
(for uniform signals (0/4 ... 20 mA, 0 ... 10 V) acc. to IEC 60381)
  - 2 or 4 configurable analogue outputs  
(with possibility of characteristic curve spread and reversal with any offset)
  - 2 or 4 configurable switching outputs  
(with potential-free relay contacts or semiconductor switches)
- Optional Modbus RTU interface
  - Units with Modbus interfaces do not have analogue nor switch outputs
- USB interface
- Mathematical functions like formulas or tables
- Optional data logger function with data storage on conventional Micro SD cards
- Configuration of all parameters and a measuring point protocol<sup>(1)</sup> are possible via an optionally available PC software

---

<sup>(1)</sup>parameter profile that can be saved and loaded

### 1.2 Function diagram

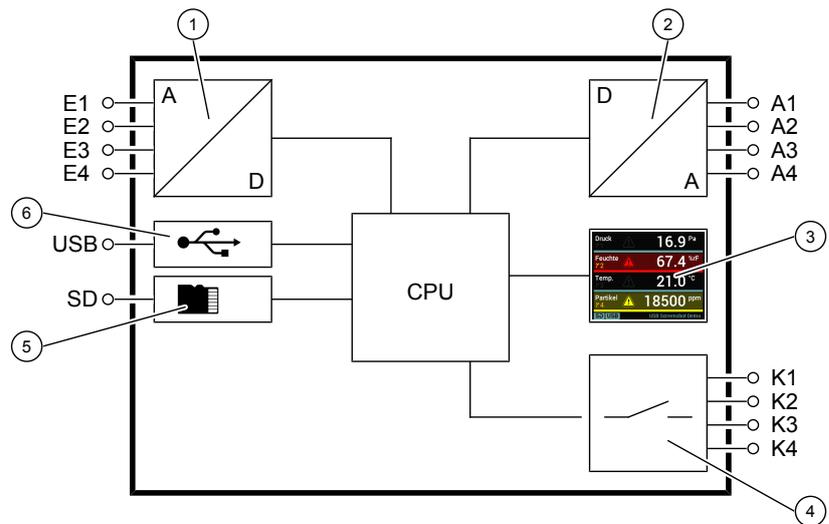


Illustration 1: Function diagram

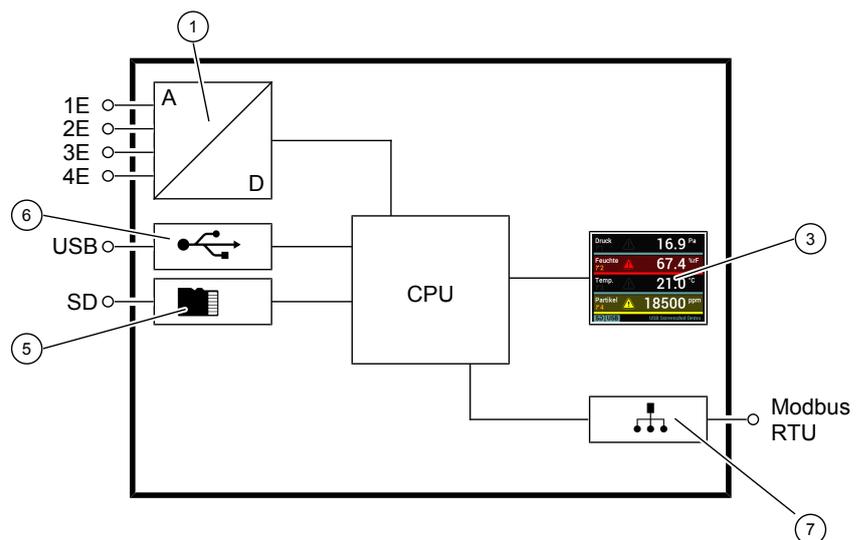


Illustration 2: Function diagram option Modbus

1	Analogue inputs	2	Analogue outputs
3	Touch colour display	4	Switching outputs
5	Micro SD memory card	6	Micro USB interface
7	Modbus interface		

### 1.3 Design and mode of operation

The measuring signals of up to four connected measuring transducers can be analysed simultaneously by the microcontroller electronics. The configurable 2.8" touch display can display up to four measuring values at the same time. A configurable colour switch serves to present specific operating modes. Optionally, the device can be delivered with a data logger function.

All parameters can also be set on the device via the touch display or (optionally) via a PC software. The measuring value display unit has a USB interface to which a USB stick can be connected for this purpose. For instance, the USB stick can be used to allow simple configurations to be exported to other devices. The PC software also allows a measuring point protocol <sup>(2)</sup>.

### Units with analogue and switch outputs

The processed input signals are converted into the following output signals:

- 2 or 4 configurable switching outputs Parameters, such as activation and deactivation points, switching function or delay, are available for this purpose. The switching states are displayed with symbols on the display.
- 2 or 4 analogue outputs with configurable output range. Every output signal can be set freely within the signal limits (see Technical Data). The characteristic curve change can be made in a linear, rooted, tabular or mathematic form proportional to the displayed value.

### Units with Modbus RTU interface

Units with Modbus RTU interface do not have analogue or switch outputs

The input signals can be queried via the Modbus and processed by the Master. For more information about this topic, please reference the product user manual and the Modbus reference manual. (<http://www.fischermesstechnik.de/de/downloads/Handbücher>)

---

<sup>(2)</sup> parameter profile

## 2 Technical Data

### 2.1 Generalities

The stated technical data only refer to the measuring value display unit EA15 and never take into account the properties of the connected measuring transducer.

### 2.2 Input variables

Depending on the model, the measured value display unit EA15 has 2 or 4 analogue inputs for measuring transducers with output signals current or voltage acc. to IEC 60381.

Input range	Min. signal range	Resolution	Input resistance	Overload protection
0 ... 20 mA	4 mA	12 Bit	$\leq 30 \Omega$	PTC max. 32 DC/ 140 mA
4 ... 20 mA	4 mA		$\leq 30 \Omega$	PTC max. 32 DC/ 140 mA
0 ... 10 V	2.5V		$\geq 200 \text{ k}\Omega$	max. 32 V

### 2.3 Output parameters

**NOTICE! Only units with analogue and switch output.**

#### 2.3.1 Analogue outputs

Depending on the model, the measured value display unit EA15 has 2 or 4 analogue inputs with programmable uniform signals acc. to IEC 60381.

Output signal	Min. signal range	Resolution	Signal range
0 ... 20 mA	4 mA	12 Bit	0.0 ... 21.5 mA
4 ... 20 mA	4 mA		0.0 ... 21.5 mA
0 ... 10 V	2.5V		0.0 ... 10.5 V

#### Apparent ohmic resistance

Output signal: Current	$U_b = 12V$	$U_b = 24V$	$U_b = 32V$
0... 20 mA	$R_L < 500\Omega$	$R_L < 700\Omega$	$R_L < 1100\Omega$
4...20 mA			
Output signal: Voltage	$U_b = 12 \dots 32 V$		
0...10V	$R_L > 1 \text{ k}\Omega$		

#### 2.3.2 Switching outputs

Depending on the model, the measured value display unit EA15 has none, 2 or 4 switch outputs with a programmable switching function. Optionally, the unit can be supplied with potential-free relay contacts or potential-free semiconductors (MOSFET).

#### Programmable switching function

Make contact (NO)
Break contact (NC)



### 2.7 Auxiliary energy

#### Supply EA15

Characteristic value	Value
Rated Voltage	24 V AC/DC
Admissible operating voltage	$U_b = 12 \dots 32$ V AC/DC
Power consumption	Max. 10W

#### Power supply measurement transducer

Supply voltage DC	Value
Output voltage	$U_b - 1.5V$
Max. output current $U_b = 12 \dots 32$ V	500 mA
PTC	8 $\Omega$

The power supply from the EA15 is secured by an internal PTC. The total power currents of the connected measuring transducers may not exceed the max. output current.

In the case of an AC power supply, the supply voltage of the measuring transducer is generated by means of a one-way rectification. The maximum output current depends on the level of the power supply:

Supply voltage AC	Value
Output voltage	One-way rectification of $U_b$
Max. output current $U_b = 12 \dots 19$ V	100 mA
$U_b = 19 \dots 32$ V	200 mA
PTC	8 $\Omega$

If the measuring transducer requires more power, this must be supplied via an external CE-conform power adapter.

#### 2.7.1 Electrical connection units with analogue and switch outputs

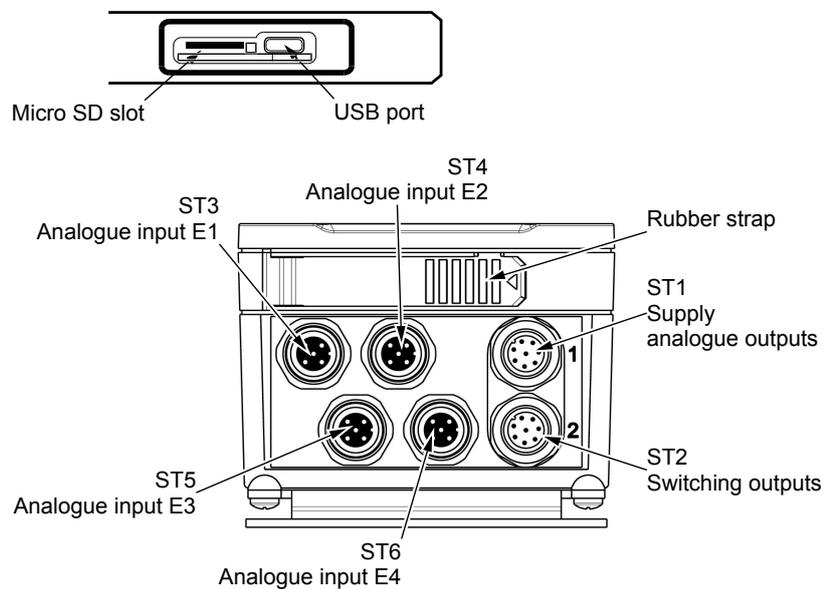


Illustration 3: M12 plug

Micro SD slot and USB jack are located behind the rubber strap.

### M12 flanged connector 8-pin

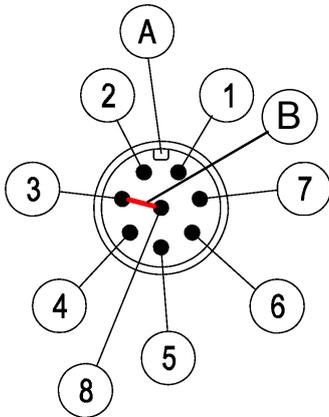


Illustration 4: M12 plug 8-pin  
+bridge

### M12 flanged connector 5-pin




Illustration 5: M12 plug 5-pin

### M12 flanged connector 8-pin

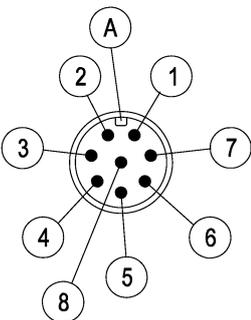


Illustration 6: M12 plug 8-pin

### Terminal assignment ST1

#### 4 channel version

PIN	Signal	Name	Cable colour
1	+U <sub>b</sub>	Supply (+)	white
2	+Sig A1	Analogue output 1 (+)	brown
3	-U <sub>b</sub>	Supply (-)	green
4	+Sig A2	Analogue output 2 (+)	yellow
5	FE	Functional earth	grey
6	+Sig A3	Analogue output 3 (+)	pink
7	+Sig A4	Analogue output 4 (+)	blau
8	-Sig A	Analogue output (-)	red
A	Type A	Plug code	
B	Bridge (-U <sub>b</sub> and -Sig A are bridged internally.)		

#### 2 channel version

PIN	Signal	Name	Cable colour
1	+U <sub>b</sub>	Supply (+)	brown
2	+Sig A1	Analogue output 1	white
3	-U <sub>b</sub> / -Sig A	Supply / analogue output (-)	blau
4	+Sig A2	Analogue output 2	Black
5	FE	Functional earth	grey
A	Type A	Plug code	

### Terminal assignment ST2

#### 4 channel version

PIN	Signal	Name	Cable colour
1	K1.1	Relay 1	white
2	K1.2	Relay 1	brown
3	K2.1	Relay 2	green
4	K2.2	Relay 2	yellow
5	K3.1	Relay 3	grey
6	K3.2	Relay 3	pink
7	K4.1	Relay 4	blue
8	K4.2	Relay 4	red
A	Type A	Plug code	

**M12 flanged connector 2 channel version 4-pin**




Illustration 7: M12 plug 4-pin

PIN	Signal	Name	Cable colour
1	K1.1	Relay 1	brown
2	K2.1	Relay 2	white
3	K2.2	Relay 2	blue
4	K1.2	Relay 1	black
A	Type A	Plug code	

**M12 flange sleeve 5-pin**

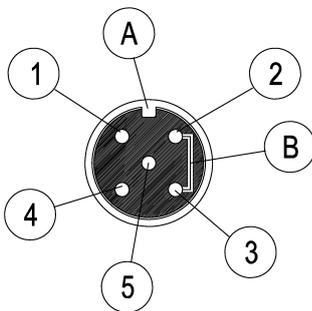


Illustration 8: M12 socket 5-pin +bridge

**Terminal assignment analogue inputs ST3 - ST6**

The occupation of the connection sockets for the external measuring transducers is the same for all inputs. The only difference is the respective <No.> of the analogue input.

PIN	Signal	Name	Cable colour
1	+U <sub>T</sub>	Transmitter supply (+)	brown
2	-Sig E<Nr.>	Analogue input (-)	white
3	-U <sub>T</sub>	Transmitter supply (-)	blau
4	+Sig E<No.>	Analogue input <No.>	Black
5	FE	Functional earth	grey
A	Type A	Plug code	
B		bridge	

**2.7.2 Electrical connection units with Modbus RTU**

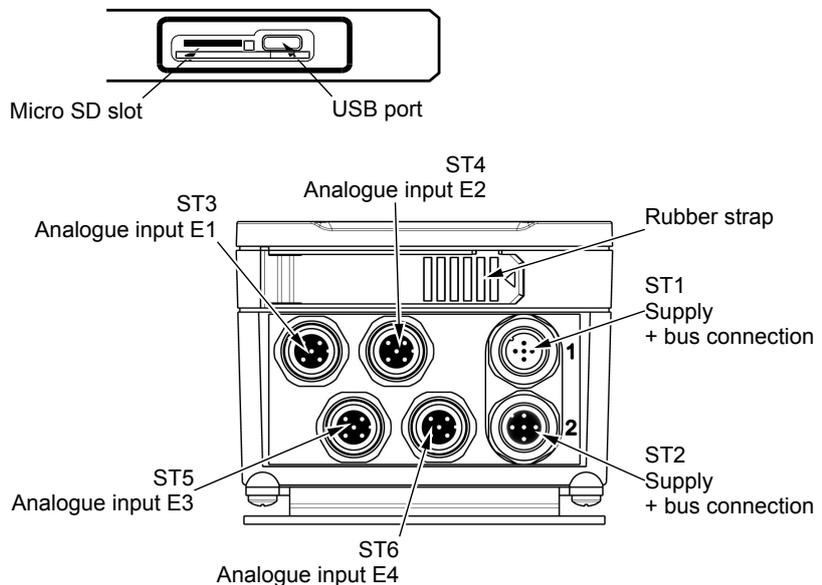


Illustration 9: M12 plug version Modbus

Micro SD slot and USB jack are located behind the rubber strap.


**M12 flanged connector 5-pin**

Illustration 10: M12 connector 5-pin

**Terminal assignment ST1**

PIN	Signal	Surname	Cable colour
1	+U <sub>b</sub>	Supply (+)	brown
2	BUS-D1	Modbus	white
3	-U <sub>b</sub>	Supply (-)	blue
4	BUS-D0	Modbus	black
5	BUS-R	Modbus	grey
A	Type A	Plug code	


**M12 flange sleeve 5-pin**

Illustration 11: M12 socket 5-pin

**Terminal assignment ST2**

PIN	Signal	Surname	Cable colour
1	+U <sub>b</sub>	Supply (+)	brown
2	BUS-D1	Modbus	white
3	-U <sub>b</sub>	Supply (-)	blue
4	BUS-D0	Modbus	black
5	BUS-R	Modbus	grey
A	Type A	Plug code	

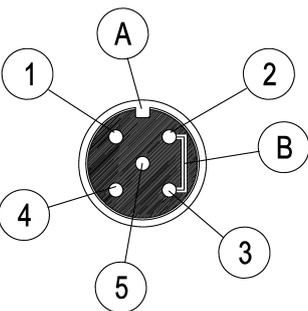
**M12 flange sleeve 5-pin**

Illustration 12: M12 bush 5-pin +bridge

**Terminal assignment analogue inputs ST3 - ST6**

The occupation of the connection sockets for the external measuring transducers is the same for all inputs. The only difference is the respective **<No.>** of the analogue input.

PIN	Signal	Name	Cable colour
1	+U <sub>T</sub>	Transmitter supply (+)	brown
2	-Sig E<Nr.>	Analogue input (-)	white
3	-U <sub>T</sub>	Transmitter supply (-)	blau
4	+Sig E<No.>	Analogue input <No.>	Black
5	FE	Functional earth	grey
A	Type A	Plug code	
B		bridge	

### 2.8 Application conditions

Characteristic value	Value
Permissible ambient temperature	-10 ... +70 °C
Admissible storage temperature	-20 ... +70 °C
Admissible media temperature	see data sheet of the connected measuring transducer
Enclosure protection class	IP 65 acc. to DIN EN 60529
EMC (204/108/EC)	EN 61326-1:2013 EN 61326-2-3:2013
RoHS (2011/65/EU)	EN 50581:2012

### 2.9 Construction design

#### Materials

Part	the material.
Housing	Polyamide PA 6.6
Rubber strap	EPDM
Sealings and gaskets	NBR
Wall mounting plate	Aluminum
Front film	Polyester

Please see the technical data about the connected measuring transducer for information about the materials that come into contact with the media.

### 2.10 Dimensional drawings

All dimensions in mm unless otherwise stated

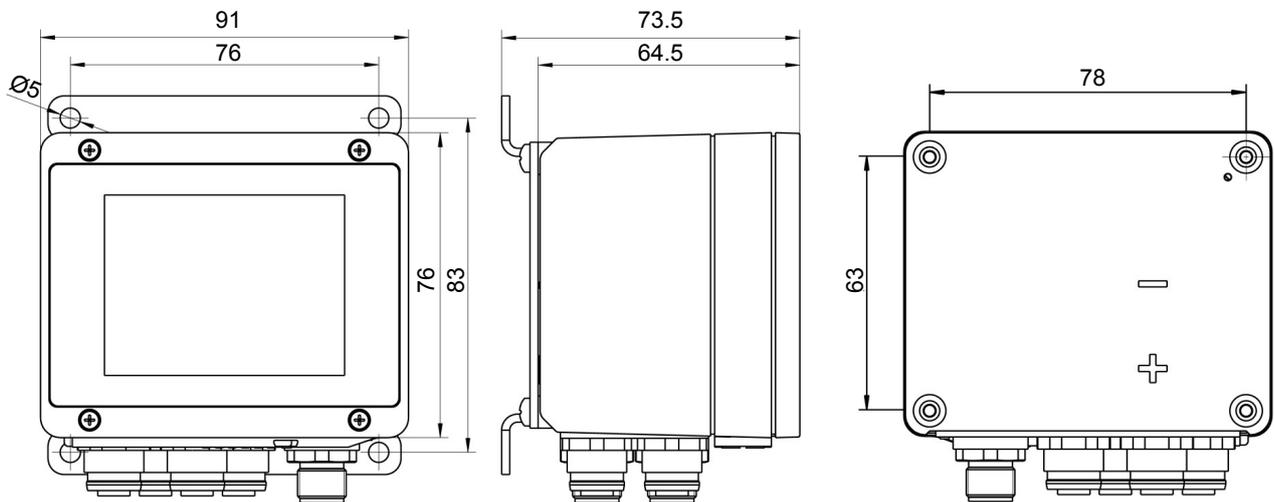


Illustration 13: Dimensional picture

### 3 Order Codes

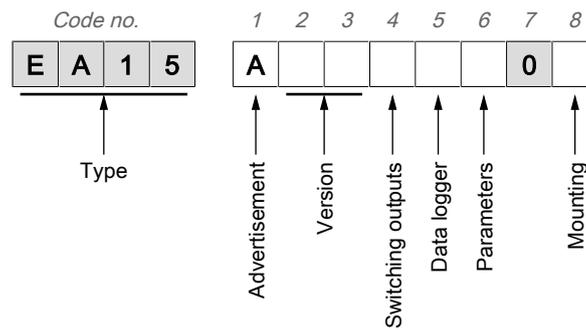


Illustration 14: Order Codes

#### Advertisement

<b>[1]</b>	← <b>Code no.</b>
<b>A</b>	2.8" TFT Touch LCD (horizontal)

#### Version

<b>[2.3]</b>	← <b>Code no.</b>
<b>20</b>	2 channels (2 inputs, 2 outputs, 2 switch outputs)
<b>2M</b>	2 channel Modbus (2 inputs, Modbus RTU interface)
<b>40</b>	4 channels (4 inputs, 4 outputs, 4 switch outputs)
<b>4M</b>	4 channel Modbus (4 inputs, Modbus RTU interface)

#### Switching outputs

<b>[4]</b>	← <b>Code no.</b>
<b>0</b>	without
<b>R</b>	with relay contacts
<b>H</b>	with semiconductor switches

#### Data logger

<b>[5]</b>	← <b>Code no.</b>
<b>0</b>	No
<b>1</b>	yes (32 GB Micro SD card)

#### Parameterization

<b>[6]</b>	← <b>Code no.</b>
<b>S</b>	Standard configuration
<b>K</b>	Customer-specific configuration

#### Assembly

<b>[8]</b>	← <b>Code no.</b>
<b>0</b>	Standard (attachment boreholes on rear side)
<b>W</b>	Wall mounting

### 3.1 Information about the document

This document contains all technical data about the device. Great care was taken when compiling the texts and illustrations; Nevertheless, errors cannot be ruled out.

Subject to technical amendments.



**FISCHER Mess- und Regeltechnik GmbH**

Bielefelder Str. 37a  
D-32107 Bad Salzuflen

Tel. +49 5222-974-0

Fax. +49 5222-7170

web : [www.fischermesstechnik.de](http://www.fischermesstechnik.de)

eMail : [info@fischermesstechnik.de](mailto:info@fischermesstechnik.de)





